


HEAD LOSS CHARACTERISTICS FOR AUTOMATIC CONTROL CHECK VALVE

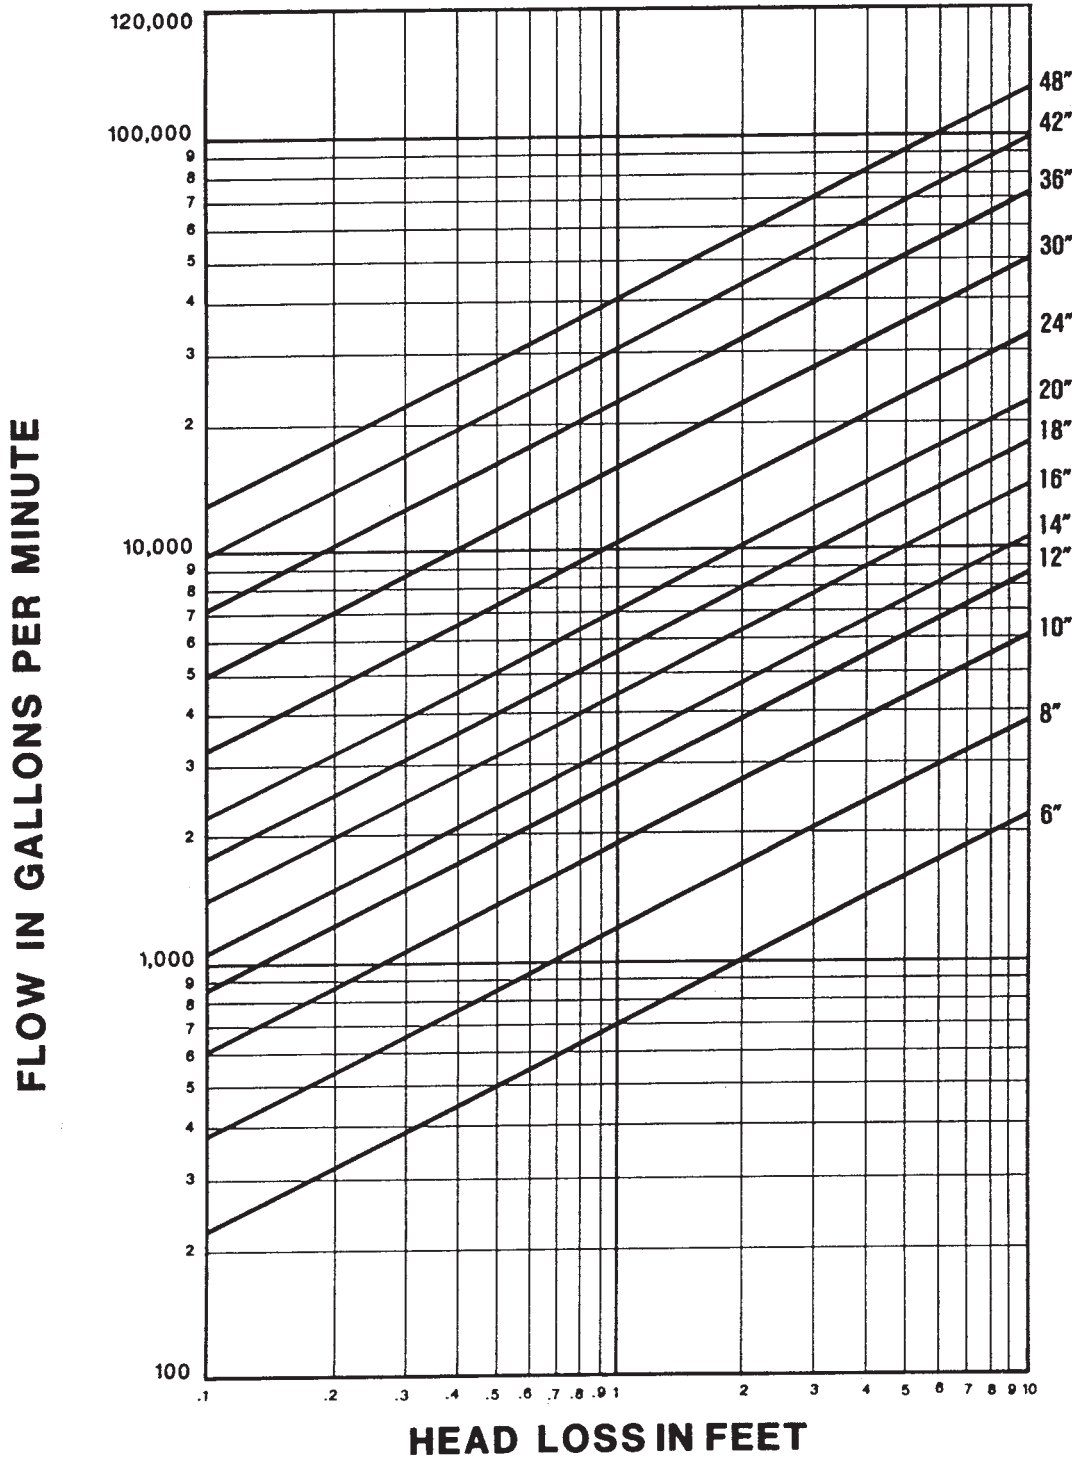

CERTIFIED FLOW TESTED

Figures shown are based on certified flow tests conducted at Utah State University, Water Research Laboratory, Report No. 299. Valves sizes 8" & 14". Actual field conditions may vary from these curves.

Note: When comparing similar competitors published data, only use certified flow test data.

DATE
09-01-03



DRWG. NO.
C-8000

SPECIFICATIONS OTHER SIDE